



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION

NOTICE OF ACCEPTANCE (NOA)

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
T (786) 315-2590 F (786) 315-2599
www.miamidade.gov/economy

AWP Windows and Doors, LLC
8130 NW 74th Avenue
Medley, FL 33166

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER - Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "440" Aluminum Fixed Window – L.M.I.

APPROVAL DOCUMENT: Drawing No. **W08-87**, titled "Series 440 Aluminum Fixed Wdw. (L.M.I.)", sheets 1 through 3 of 3, dated 10/28/08, with revision E dated 06/07/16, prepared by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant.

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state, model/series, and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **revises NOA# 13-0828.06** and consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Jorge M. Plasencia, P.E.**



NOA No. 15-1216.05
Expiration Date: January 01, 2019
Approval Date: June 23, 2016
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
(Submitted under NOA No. 08-1030.08)
2. Drawing No. **W08-87**, titled "Series 440 Aluminum Fixed Wdw. (L.M.I.)", sheets 1 through 3 of 3, dated 10/28/08, with revision **E** dated 06/07/16, prepared by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P. E.

B. TESTS

1. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
6) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94
along with marked-up drawings and installation diagram of a series "Impact View" aluminum fixed window, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-5625**, dated 07/12/08, signed and sealed by Carlos S. Rionda, P.E.
(Submitted under NOA No. 08-1030.08)

C. CALCULATIONS:


2. Anchor verification calculations and structural analysis, complying with FBC-2014, 5th edition, prepared by Al-Farooq Corporation, dated 04/17/15 and last revised on 06/09/16, signed and sealed by Javad Ahmad, P.E.
3. Glazing complies with **ASTM E1300-09**

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **15-1201.11** issued to **Eastman Chemical Company (MA)** for their "**Saflex Clear and Color Glass Interlayers**" dated 03/17/16, expiring on 05/21/21.



Jorge M. Plasencia, P.E.
Product Control Unit Supervisor
NOA No. 15-1216.05
Expiration Date: January 01, 2019
Approval Date: June 23, 2016

AWP Windows and Doors, LLC


NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

F. STATEMENTS

1. Statement letter of conformance, complying with **FBC-2014**, and of no financial interest, dated 04/21/15, signed and sealed by Javad Ahmad, P.E.
2. Sales agreement between AWP, LLC (Acquiror) and Arch Aluminum & Glass Enterprise, a Delaware Corp (Asset Seller) dated MAR 20, 2014, signed by Paul Schmitz, President and Tim Morris Jr., President, respectively.
3. Statement letter dated April 20, 2015, issued by Trulite Window & Door Solution, LLC, stating Trulite has legally sold to AWP Windows and Doors, LLC, all the NOA(s) per schedule A and gave-up all rights to NOA(s) and request to rescind all NOA(s) under Trulite, signed by Kevin Barret, CFO (Trulite).
4. Statement letter dated July 15, 2014 requesting name change from Trulite windows and doors solution, LLC to AWP windows and Doors, LLC, signed by Gerardo Beros, Director of Engineering (AWP).

G. OTHERS

1. Notice of Acceptance No. **13-0828.06**, issued to Trulite Window & Door Solutions, LLC for their Series "440" Aluminum Fixed Window – L.M.I., approved on 11/07/13 and expiring on 01/01/19.



Jorge M. Plasencia, P.E.
Product Control Unit Supervisor
NOA No. 15-1216.05
Expiration Date: January 01, 2019
Approval Date: June 23, 2016

DESIGN LOAD CAPACITY - PSF			
WINDOW DIMS.		7/16" LAM. GLASS	
WIDTH	LENGTH	EXT. (+)	INT. (-)
36"	50-5/8"	80.0	120.0
37"		77.8	116.8
42"		68.6	102.9
48"		60.0	90.0
53-1/8"		56.9	85.3
60"	63"	56.9	85.3
36"		80.0	120.0
37"		77.8	116.8
42"		68.6	102.9
48"		60.0	90.0
53-1/8"		54.2	81.3
36"	74-1/4"	80.0	120.0
37"		77.8	116.8
42"		68.6	102.9
36"	80"	80.0	120.0
37"		77.8	116.8
42"		68.6	102.9
36"	84"	80.0	120.0
37"		77.8	116.8
36"	95"	80.0	120.0

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE
BASED ON ASTM E1300-09 (3 SEC. GUSTS).

SERIES 440 ALUMINUM FIXED WINDOW

DESIGN LOAD RATINGS FOR THESE WINDOWS TO BE AS PER
CHART SHOWN ABOVE.

APPROVAL APPLIES TO SINGLE UNITS OR SIDE BY SIDE COMBINATIONS
OF FIX./FIX. OR FIXED WDW. WITH OTHER MIAMI-DADE COUNTY
APPROVED WINDOWS USING MIAMI-DADE COUNTY APPROVED MULLIONS
IN BETWEEN.
LOWER DESIGN PRESSURE FROM WINDOWS OR MULLION APPROVAL
WILL APPLY TO ENTIRE SYSTEM.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE
REQUIREMENTS OF THE 2014 (5TH EDITION) FLORIDA BUILDING CODE
INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER
LOADS TO THE STRUCTURE.


ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS, ANCHORS
EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS ARE
NOT PART OF THIS APPROVAL.


A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

ALL SHIMS TO BE HIGH IMPACT, NON-METALLIC AND NON-COMPRESSIBLE.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT
COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE
REQUIREMENTS OF THE 2014 FLORIDA BUILDING CODE & ADOPTED STANDARDS.

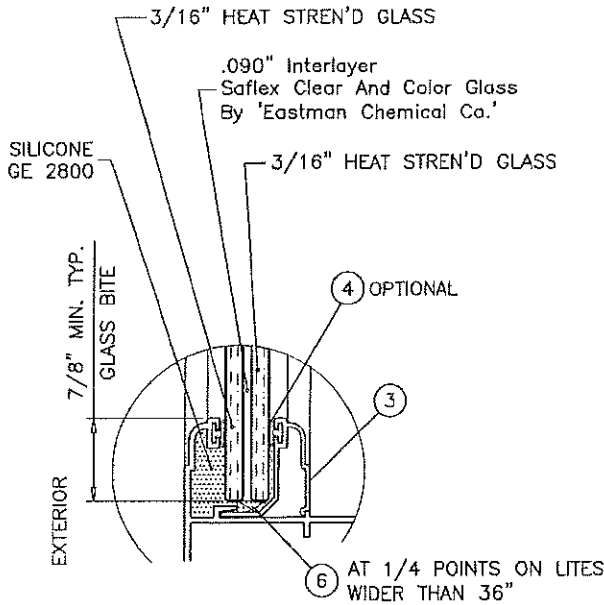

GLAZING DETAIL

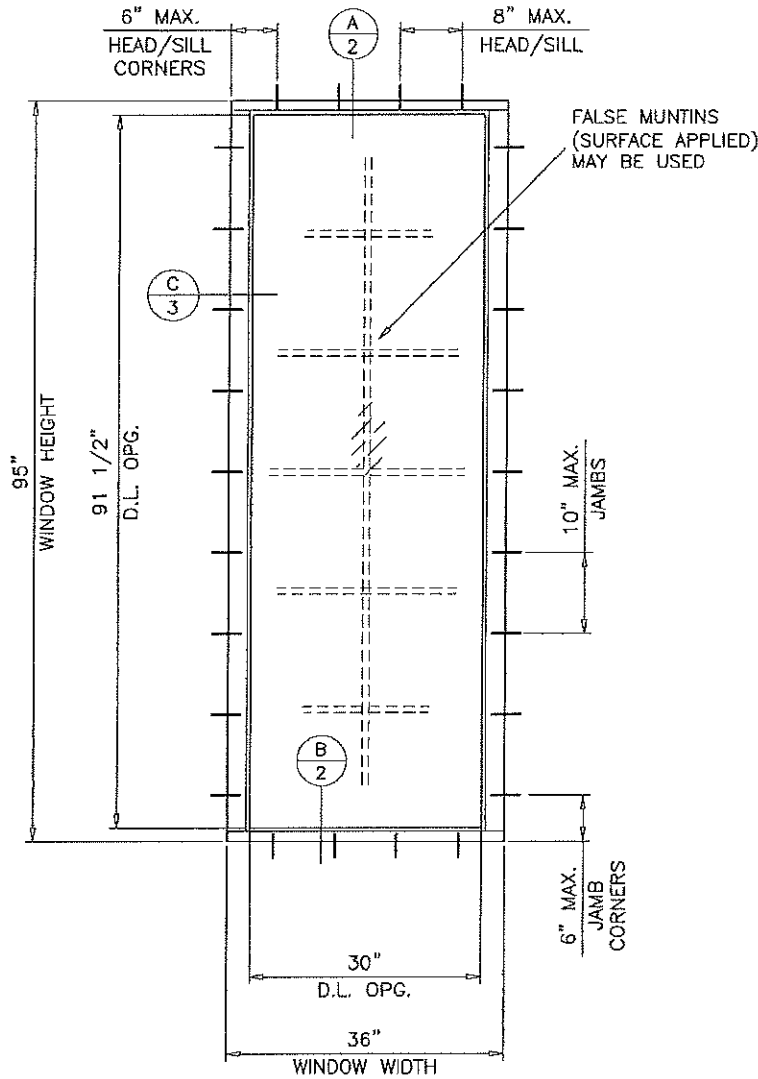

TYPICAL ELEVATION
TESTED UNIT


GLASS D.L.O. DIMS.
D.L.O. HEIGHT = WINDOW HEIGHT - 3.50"
D.L.O. WIDTH = WINDOW WIDTH - 6.0"

THESE WINDOWS ARE RATED FOR LARGE & SMALL MISSILE IMPACT.
SHUTTERS ARE NOT REQUIRED.

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. **15-1216.05**

Expiration Date **01/01/2019**

By 
Miami-Dade Product Control

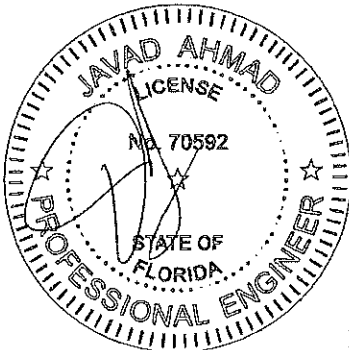

JUN 09 2016





af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 262-6978 FAX (305) 262-6978
COMP - ANL W08-87AWP

SERIES 440 ALUMINUM FIXED WDW. (L.M.I.)
AWP WINDOWS AND DOORS, LLC
8130 N.W. 74TH AVE.
MEDLEY, FL. 33166
TEL. (305) 887-2646 FAX (305) 883-1309

NO.	DATE	BY	DESCRIPTION
A	05.27.10	MANUF.	NAME REVISED
B	12.23.11	UPDATED TO 2010 FBC.	NAME REV
C	10.30.13	INTERLAYER NAME REV.	
D	04.23.15	UPDATED TO 2014 FBC	
E	06.07.16	REV. PER PER COMMENTS	

date: 10-28-08
scale: 1/2"=1'-0"
dr. by: HAMID
chk. by:

drawing no.
W08-87
sheet 1 of 3

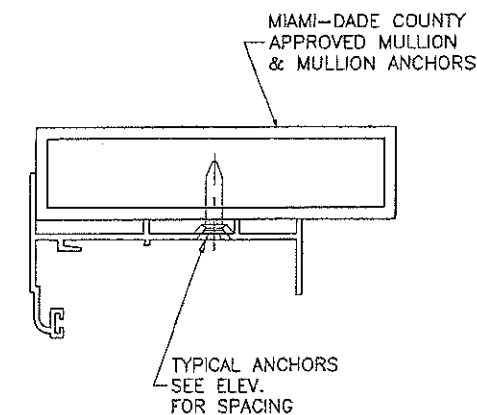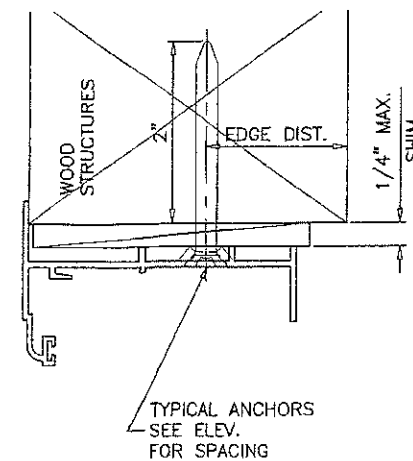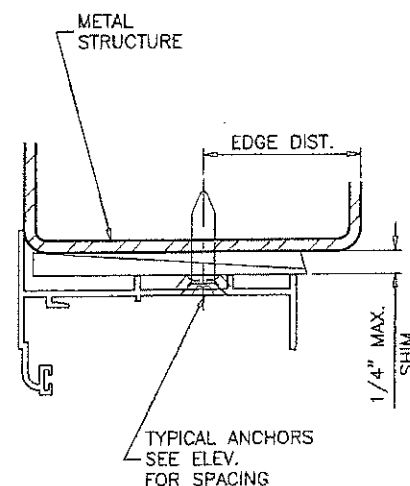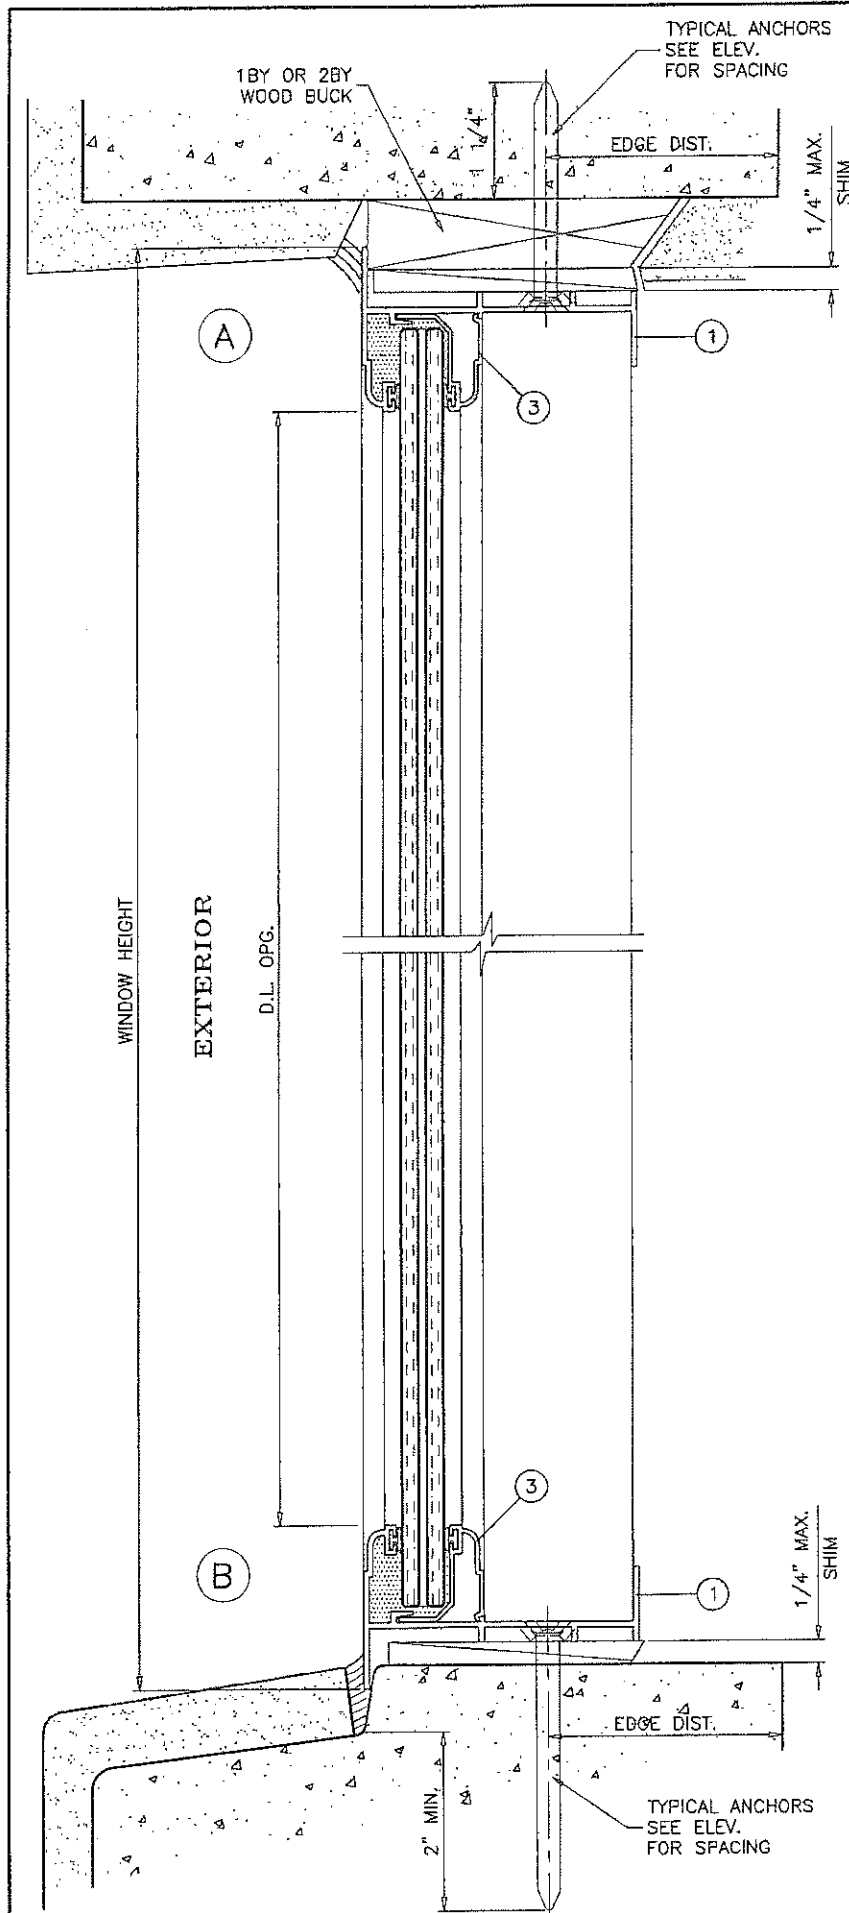

WOOD BUCKS AND METAL STRUCTURE NOT BY AWP WINDOWS MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

SEALANTS:

FRAME CORNERS AND INSTALLATION SCREWS AT SILL SEALED WITH WHITE/ALUMINUM COLORED SEALANT.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

1/4" DIA. TAPCON BY 'ITW' (Fu=125 KSI, Fy=100 KSI)

1/4" DIA. ULTRACON BY 'ELCO' (Fu=177 KSI, Fy=155 KSI)

INTO WOOD STRUCTURES

2" MIN. PENETRATION INTO WOOD (HEAD/SILL/JAMBS)

THRU 1BY OR 2BY BUCKS INTO CONC. OR MASONRY

1-1/4" MIN. EMBED INTO CONCRETE (HEAD/SILL/JAMBS)

1-1/4" MIN. EMBED INTO MASONRY (JAMBS)

DIRECTLY INTO CONCRETE OR MASONRY

2" MIN. EMBED INTO CONCRETE (HEAD/SILL/JAMBS)

2" MIN. EMBED INTO MASONRY (JAMBS)

#14 SMS OR SELF DRILLING SCREWS (GRADE 2 CRS)

INTO METAL STRUCTURES (HEAD/SILL/JAMBS)

ALUMINUM: 1/8" THK. MIN. (6063-T5 MIN.)

STEEL: 1/8" THK. MIN. (Fy = 36 KSI MIN.)

(STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

#12 SMS OR SELF DRILLING SCREWS (GRADE 2 CRS)

INTO MIAMI-DADE COUNTY APPROVED MULLIONS

ALUMINUM: 1/8" THK. MIN. (6063-T5 MIN.) (NO SHIM SPACE)

STEEL: 1/8" THK. MIN. (Fy = 36 KSI MIN.) (NO SHIM SPACE)

(STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

TYPICAL EDGE DISTANCE

INTO CONCRETE AND MASONRY = 2-1/2" MIN.


INTO WOOD STRUCTURE = 1" MIN.

INTO METAL STRUCTURE = 3/4" MIN.

WOOD AT HEAD, SILL OR JAMBS SG = 0.55 MIN.

CONCRETE AT HEAD, SILL OR JAMBS f'c = 3000 PSI MIN.

C-90 HOLLOW/FILLED BLOCK AT JAMBS f'm = 2000 PSI MIN.

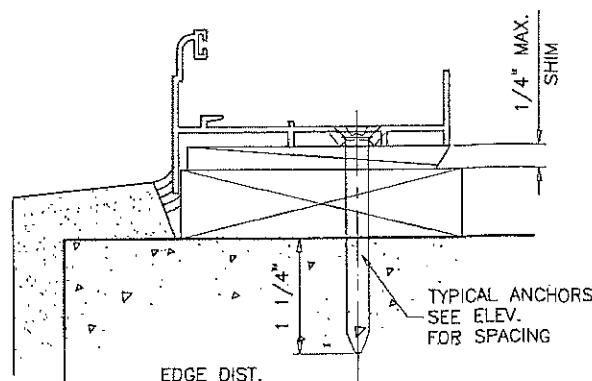


PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. **15-1216.05**

Expiration Date **01/01/2019**

By *[Signature]*
Miami-Dade Product Control

JUN 09 2016

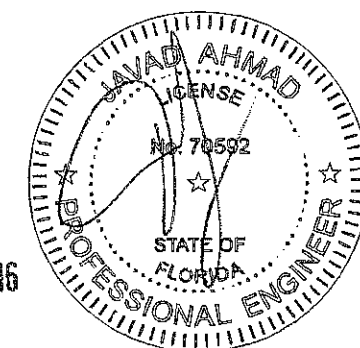

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978


COMP-ANL\W08-87AWP

SERIES 440 ALUMINUM FIXED WDW. (L.M.I.)
AWP WINDOWS AND DOORS, LLC
8130 N.W. 74TH AVE.
MEDLEY, FL. 33166
TEL. (305) 887-2646 FAX (305) 883-1309





revisions:	no	date	by	description
	A	05.27.10		MANUF. NAME REVISED
	B	12.23.11		MANUF. NAME REVISED
	C	10.30.13		NO CHANGE THIS SHEET
	D	04.23.15		UPDATED TO 2014 FBC
	E	06.07.16		REV. PER RER COMMENTS

date: 10-28-08
scale: 1/2" = 1"
dr. by: HAMID
chk. by:


drawing no.
W08-87
sheet 2 of 3

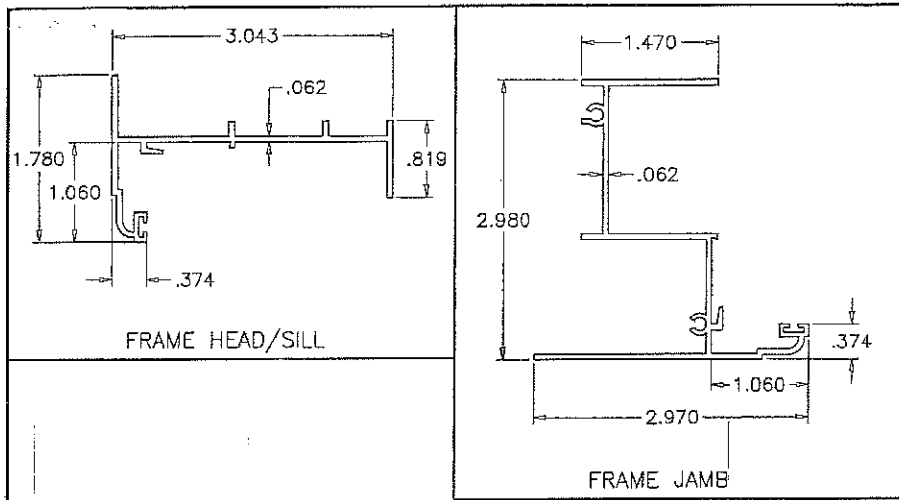

ITEM #	PART #	REQD.	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	YE-1700	1	FRAME HEAD/SILL	6063-T6	-
2	YE-1702	2	FRAME JAMB	6063-T6	-
3	YE-1707	AS REQD.	GLAZING BEAD	6063-T6	-
4	YH-622	AS REQD.	GLAZING BULB VINYL	-	SULLIVAN & SULLIVAN
5	YF-10	AS REQD.	FRAME ASSEMBLY SCREWS	-	#8 X 1" P.H. SMS
6	-	AS REQD.	SETTING BLOCKS	EPDM	DUROMETER 80±5 SHORE A

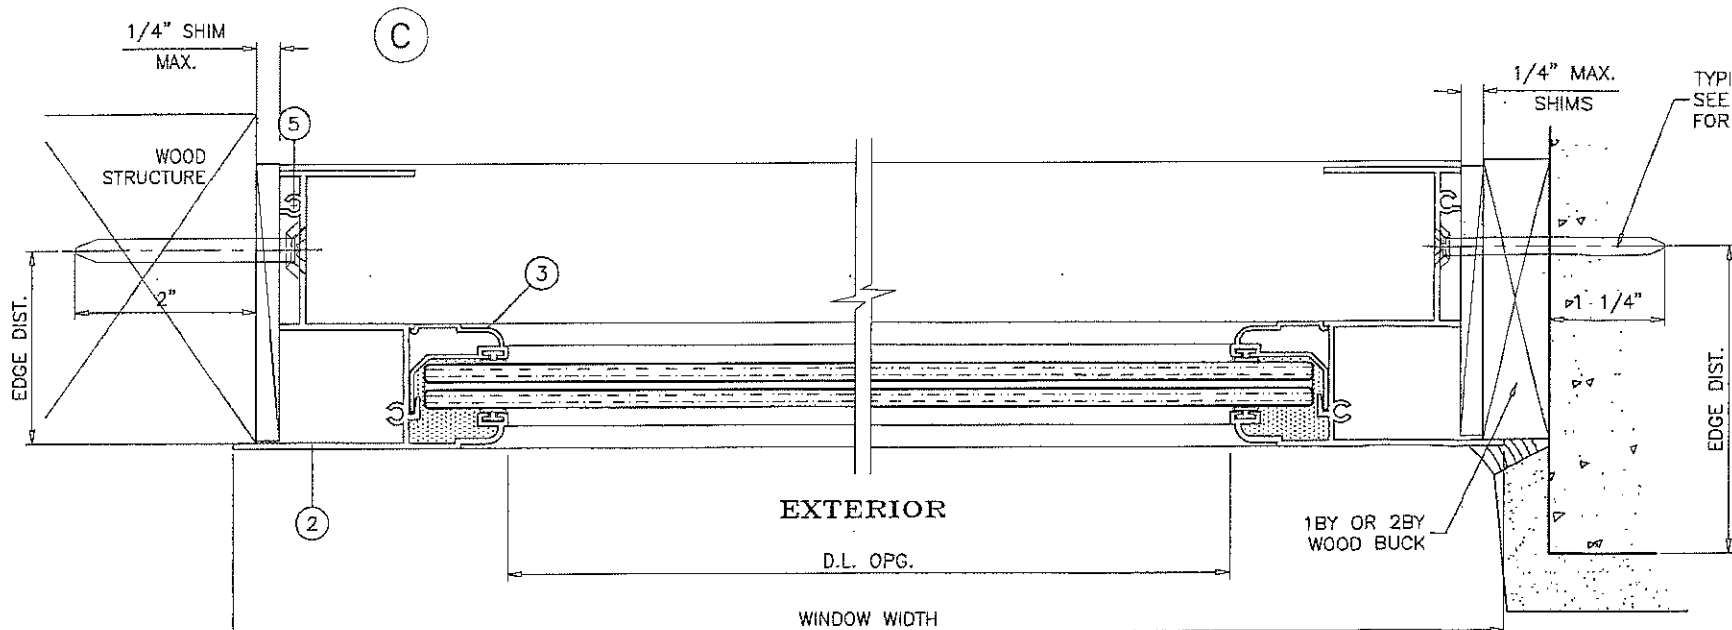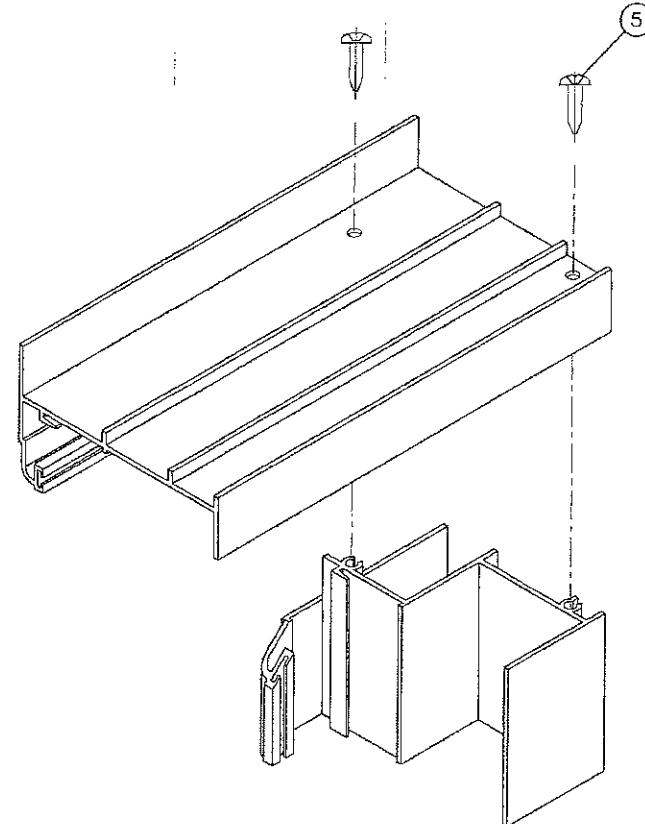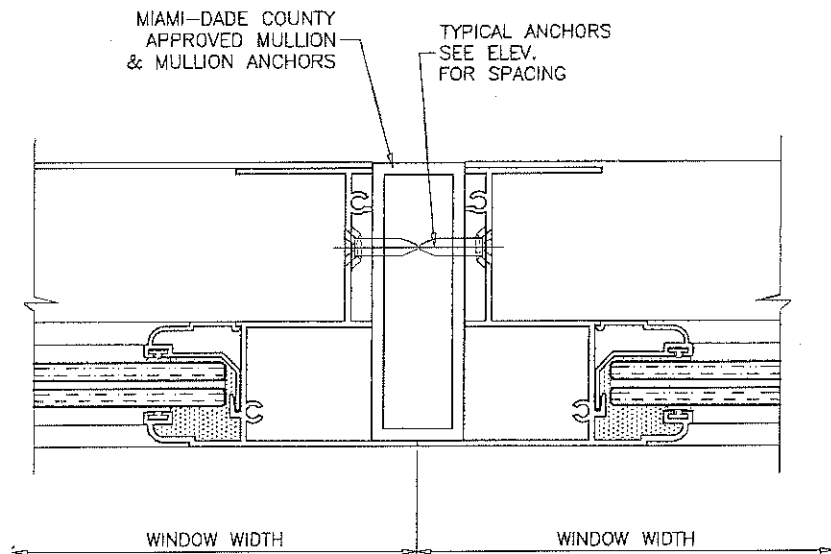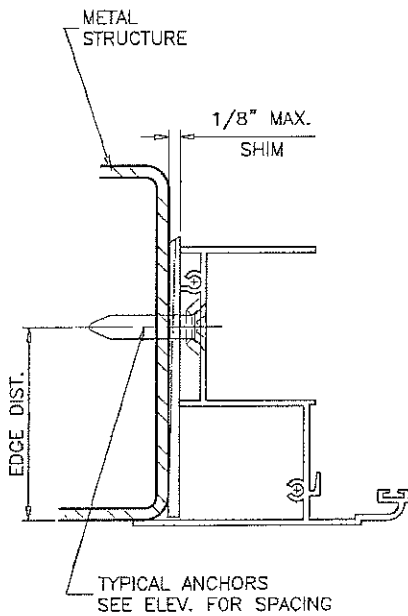

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. **15-1216.05**
Expiration Date **01/01/2019**
By *[Signature]*
Miami-Dade Product Control

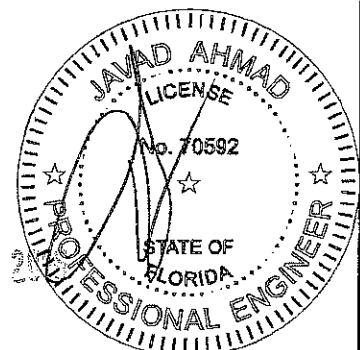

SERIES 440 ALUMINUM FIXED WDW. (L.M.I.)
AWP WINDOWS AND DOORS, LLC
8130 N.W. 74TH AVE.
MEDLEY, FL. 33166
TEL. (305) 887-2846 FAX (305) 883-1309

NO.	DATE	BY	DESCRIPTION
A	05.27.10	MANUF. NAME	REVISED
B	12.23.11	MANUF. NAME	REVISED
C	10.30.13	NO CHANGE	THIS SHEET
D	04.23.15	UPDATED TO	2014 FBC
E	06.07.16	REV. PER	REMARKS

date: 10-28-08
scale: 1/2" = 1"
dr. by: HAMID
chk. by:
drawing no.
W08-87
sheet 3 of 3

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL W08-87AWP